



NOTES


1. Steel tie rods to be heavily coated with asphalt after installation.
2. Restrained joints may be substituted for tie rods.
3. Surface of ground within 900 mm of hydrant shall be smooth.

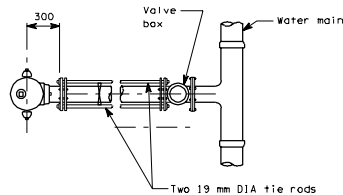

PLAN




PLAN

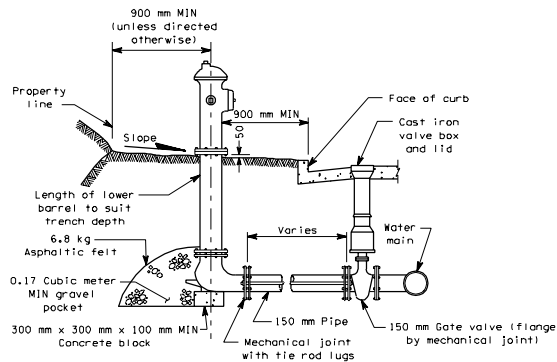

ELEVATION

TYPE A

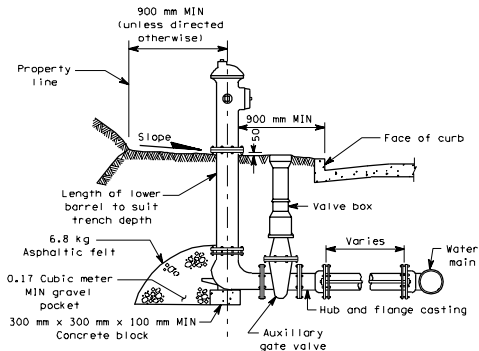

ELEVATION

TYPE B

ALL DIMENSIONS ARE IN MILLIMETERS
UNLESS OTHERWISE NOTED

HYDRANT SETTING TYPES A AND B